
VIDI-AC-2CS Access Controller/ Reader

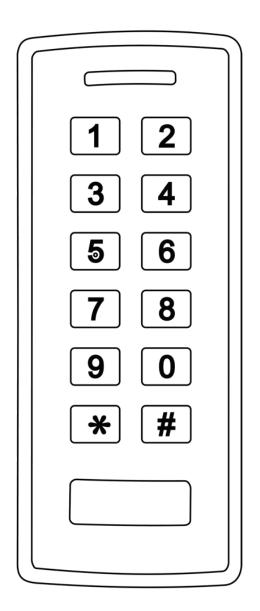

User Manual

CONTENTS

INTRODUCTION
INSTALLATION4
STANDALONE MODE 6
CONTROLLER MODE
WIEGAND READER MODE 13
ADVANCE APPLICATION14

INTRODUCTION

The VIDI-AC-2CS is a single door multifunction standalone access controller or a Wiegand output reader. It uses Atmel MCU assuring stable performance. The operation is very user-friendly, and low-power circuit makes it long service life.

The VIDI-AC-2CS supports 1,000 users (998 common users + 2 panic users), all user data can be transferred from one to another (Max 10pcs). It supports multi access modes in either card access, PIN access, Card + PIN access, or multi cards/PINs access. It has extra features including block enrollment, interlocked, Wiegand 26~37 bits interface...etc.

Features


- Waterproof, conforms to IP66
- One relay, keyboard programmer
- 1,000 users (998 common users + 2 panic users)
- PIN length: 4~6 digits
- Card type: reads 125KHz EM card
- Wiegand 26~37 bits input & output
- Can be used as Wiegand reader with LED & Buzzer output
- Card block enrolment
- Tri-colour LED status display
- Integrated alarm & buzzer output
- Pulse mode, Toggle mode
- User data can be transferred
- 2 devices can be interlocked for 2 doors
- Built in light dependent resistor (LDR) for anti tamper
- Backlit keypad
- Low temperature resistance(-40°C)

Specifications

User Capacity	1000
Common User	998
Panic User	2
Operating Voltage	12~18V DC
Idle Current	<35mA
Proximity Card Reader	EM or HID& EM
Radio Technology	125KHz Proximity Card
Read Range	2~6 cm
Wiring Connections	Relay Output, Exit Button, Alarm, Door
	Contact, Wiegand Input, Wiegand Output
Relay	One (NO, NC, Common)


Adjustable Relay Output	1~99 Seconds (5 seconds default)
Time	2 Amp Maximum
Lock Output Load	
Wiegand Interface	Wiegand 26-37 bits
Wiegand Input	26-37 bits
Wiegand Output	26-37 bits
Pin Output	4 bits, 8 bits(ASCII), 10 digits Virtual
	Number
Environment	Meets IP66
Operating Temperature	-40°C ~ 60°C (-40°F~ 140°F)
Operating Temperature Operating Humidity	-40°C ~ 60°C (-40°F~ 140°F) 0%RH~98%RH
1 0 1	· · · · · · · · · · · · · · · · · · ·
Operating Humidity	0%RH~98%RH
Operating Humidity Physical	0%RH~98%RH ABS Shell
Operating Humidity Physical Colour	0%RH~98%RH ABS Shell Black

Carton Inventory!!!

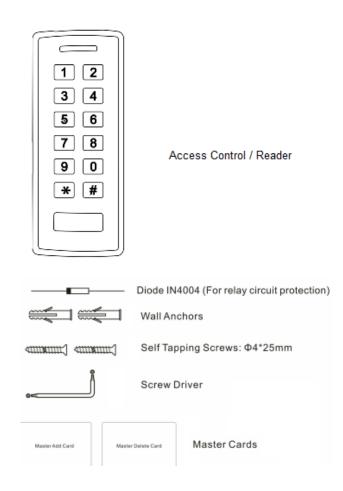

INSTALLATION

- Remove the back cover from the unit
- Drill 2 holes(A,C) on the wall for the screws and one hole for the cable
- Knock the supplied rubber bungs to the screw holes(A,C)
- Fix the back cover firmly on the wall with 4 flat head screws
- Thread the cable through the cable hole(B)
- Attach the unit to the back cover

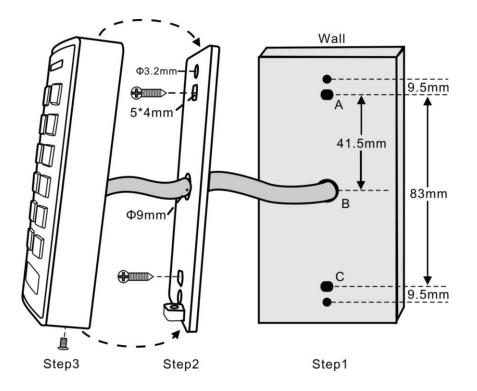

Wiring

Wire Color	Function	Notes	
Basic Standalone Wiring			
Red	DC +	12-18V DC Power Input	
Black	GND	Negative Pole of DC Power Input	
Blue	Relay NO	Normally Open Relay Output (install diode provided)	
Purple	Relay Common	Common Connection for Relay Output	
Orange	Relay NC	Normally Closed Relay Output (Install diode provided)	
Yellow	OPEN	Request to Exit(REX) Input	
Pass-Throu	Pass-Through Wiring (Wiegand Reader or Controller)		
Green	Data 0	Wiegand Output (Pass-through) Data 0	
White	Data 1	Wiegand Output (Pass-through) Data 1	
Advanced I	Advanced Input and Output Features		
Grey	Alarm Output	Negative contact for Alarm	
Brown	Contact Input	Door/Gate Contact Input (Normally Closed)	

Sound and Light Indication

Operation Status	LED	Buzzer
Stand by	Red light bright	-
Enter into programming mode	Red light shines	One beep
In the programming mode	Orange light bright	One beep
Operation error	-	Three beeps
Exit from the programming mode	Red light bright	One beep
Open lock	Green light bright	One beep
Alarm	Red light Shines quickly	Beeps

Basic Configure

Enter and Exit Program mode

Programming Step	Keystroke Combination
Enter Program Mode	* (Master Code) #
	(Factory default is 123456)
Exit Program Mode	*

Set Master Code

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Update Master Code	0 (New Master Code) # (Repeat New Master Code)
	#
	(Master code is any 6 digits)
3. Exit Program Mode	*

Set the Working Mode


Notes: the device has 3 working modes: Standalone Mode, Controller Mode, Wiegand Reader Mode, choose the mode you use. (Factory default is Standalone Mode / Controller Mode)

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Standalone/Controller Mode	7 2 # (Factory default)
OR	
2. Wiegand Reader Mode	73#
3. Exit	*

STANDALONE MODE

Device can be worked as Standalone Reader for single door. (Factory default mode)---7 2 #

Connection Diagram

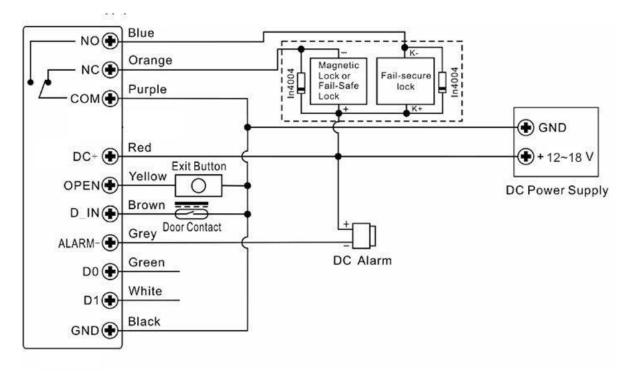


DC Power Supply:

Attention:

Install a 1N4004 or equivalent diode is needed when use a common power supply, or the keypad might be damaged. (1N4004 is included in the packing)

Access Control Power Supply:

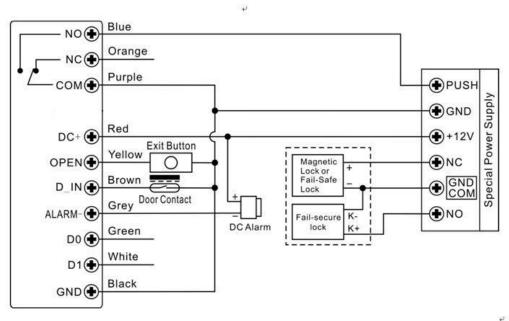

Programming

Programming will vary depending on access confirguration. Follow the instructions according to your access configuration.

Notes:

- User ID number: Assign a user ID to the access card / PIN in order to track it. The common user ID number can be any number fom 0~997, the panic user ID is from 998~999. IMPORTANT: User IDs do not have to be proceeded with any leading zeros. Recording of User ID is critical. Modifications to the user require the User ID be available.
- Proximity Card: Any 125KHz industry standard 26 bits EM card
- **PIN:** Can be any 4~6 digits except 8888 which is reserved.

Add Common Users

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
Add Card User	
2. Add Card: Using Auto ID	1 (Read Card) #
(Allows device to assign Card to next	The cards can be added continuously.
available User ID number)	
OR	
2. Add Card: Select Specific ID	1 (User ID) # (Read Card) #
(Allows Master to define a specific User ID	(User ID is any number from 0-997)
to associate the card to)	
OR	
2. Add Card: by Card Number	1 (Input 8/10 digits Card number) #
OR	
2. Add Card: Block Enrolment	1 (User ID) # (Card quantity) # (The first
(Allows Master to add up to 998 cards to	card number) #
the Reader in a single step)	Cards' number must be consecutive;
Takes 2 minutes to program.	Card quantity = number of cards to be enrolled.
Add PIN User	
2. Add PIN: Using Auto ID	1 (PIN) #
(Allows device to assign PIN to next	The PINs can be added continuously.
available User ID number)	(PIN: 4~6 digits)
2. Add PIN: Select Specific ID	1 (User ID) # (PIN) #
(Allows manager to define a specific User	The user ID is any number from 0-997.
ID to associate the PIN to)	
3. Exit	*

Add Panic Users

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Add Card:	1 (User ID) # (Read Card / Input 8/10 digits
	Card number) #
OR	
2. Add PIN:	1 (User ID) # (PIN) #
	(User ID is any number from 998-999)
3. Exit	*

Change PIN Users

Programming Step	Keystroke Combination
------------------	-----------------------

Note: Below is done outside programming mode, users can undertake this themselves	
2. Change PIN: By Card	* (Read Card) (Old PIN) # (New PIN) #
(There will auto allocate PIN(8888) to cards	(Repeat New PIN) #
when adding)	
2. Change PIN: By PIN	* (User ID) # (Old PIN) # (New PIN) #
	(Repeat New PIN) #
3. Exit	*

Delete Users

Programming Step	Keystroke Combination	
1. Enter Program Mode	* (Master Code) #	
Delete Card User - Common		
2. Delete Card - By Card	2 (Read Card) #	
OR	The cards can be deleted continuously.	
2. Delete Card - By ID number	2 (User ID) #	
OR		
2. Delete User - By Card number	2 (Input 8/10 digits Card number) #	
Delete PIN User - Common		
2. Delete PIN – by PIN	2 (Input PIN) #	
OR		
2. Delete PIN – By ID number	2 (User ID) #	
Delete Panic User		
2. Delete Panic Card User	2 (User ID) #	
OR		
2. Delete Panic PIN User	2 (User ID) #	
Delete All Users		
Delete All User	2 (Master Code) #	
3. Exit	*	

Set Relay Configuration

The relay configuration sets the behaviour of the output relay on activation.

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Pulse Mode	3 (1-99) # (factory default)
	The relay time is 1-99 seconds. (1 is 50mS.)
OR	(Default is 5 seconds)
2. Toggle Mode	30#
	Sets the relay to ON/OFF Toggle mode
3. Exit	*

Set Access Mode

For Multi cards/ PINs access mode, the interval time of reading cards/inputting PINs can not exceed 5 seconds, or else, the device will exit to standby automatically.

Programming Step Keystroke Combination
--

1. Enter Program Mode	* (Master Code) #
2. Card access	40#
OR	
2. Card + PIN access	41#
OR	
2. Card or PIN access	42#
OR	
2. Multi cards /PINs access	4 3 (2~9) #
	(Only after reading 2~9 cards or inputting 2~9
	PINs, the door can be opened)
3. Exit	*

Set Strike-out Alarm

The strike-our alarm will engage after 10 failed card attempts (Factory is OFF). It can be set to deny access for 10 minutes after engaging or disengage only after entering a valid card/PIN or Master code.

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Strike-Out OFF	60# (factory default)
OR	
2. Strike-Out ON	6 1 # Access will be denied for 10 minutes
OR	
2. Strike-Out ON (Alarm)	62#
	5 (0 ~ 30) # (factory default is 1 minute)
Set alarm time	Enter Master code # or valid user card /PIN to
	silence
3. Exit	*

Set Audible and Visual Response

Programming Step	Keystroke Com	bination
1. Enter Program Mode	* (Master Code)	#
2. Control Sounds	OFF = 7 0 #	ON = 7 1 #
OR		
2. Control LED	OFF = 7 4 #	ON = 7 5 #
OR		
2. Control Keypad Backlit	OFF = 7 6 #	ON = 7 7 #
		(factory defaults are ON)
3. Exit	*	

Programming Step	Keystroke Combination
	* (Master Code) #
2. Read HID & EM card	
OR	
2. Read EM card ONLY	
OR	
2. Read HID card ONLY	
3. Exit	*

Master Cards Usage

Using Master Cards to add and delete card / PIN users		
Add a User	1. (Read Master Add Card)	
	2. (Read User Card) / (Input User PIN #)	
	Repeat Step 2 for additional user cards / PINs	
	3. (Read Master Add Card)	
Delete a User	1. (Read Master Delete Card)	
	2. (Read User Card) / (Input User PIN #)	
	Repeat Step 2 for additional user cards/ PINs	
	3. (Read Master Delete Card)	

Users Operation & Reset to Factory Default

- Open the door: Read valid user card or inputting valid user PIN
- Remove Alarm: Read valid user card or inputting valid user PIN, or input Master Code #

- **To reset to factory default & Add Master Cards**: power off, press the Exit Button, hold it and power on, there will be two beeps, and the LED light turns into yellow, release the exit button, then read any two 125KHz EM cards or HID cards, the LED will turn into red, means reset to factory default successfully. Of the two cards reading, the 1st one is Master Add Card, the 2nd one is the Master Delete Card.

Remarks:


(1)If no Master Cards added, must press the Exit Button for at least 10 seconds before release.

(2) Reset to factory default, the user's information is still retained.

CONTROLLER MODE

Device can work as Controller, connected with the external Wiegand reader. (Factory default mode)---7 2 #

Connection Diagram

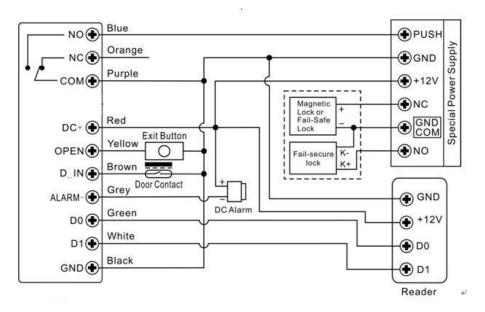

Attention: Install a 1N4004 or equivalent diode is needed when use a common power supply, or the reader might be damaged. (1N4004 is included in the packing)

Set Wiegand Input Formats

Please set the Wiegand input formats according to the Wiegand output format of the external Reader.

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Wiegand input bits	8 (26~37) # (factory default is 26bits)
3. Exit	*

Programming

- Basic Programming is the same as Standalone Mode

- There are some exceptions for your attention:

Device Connected with External Card Reader:

- If EM card reader or HID card reader: users can be added/deleted on either device or external reader.
- If Mifare reader: users **can only be** added/deleted on external reader.

Device Connected with Fingerprint Reader:

For example:

Connect the fingerprint reader to device, it is of two steps to enroll the valid fingerprint.

Step 1: Add the Fingerprint (A) on fingerprint reader

Step 2: Add the same Fingerprint(A) on 2CS:

1.	Enter Program Mode : * (Master Code) #
2.	1 (Press Fingerprint A once on F1) # (ID auto allocated)
OR	
2.	1 (User ID) # (Press Fingerprint A on F1) # (Select specific ID)
3.	Exit: *

2CS Connected with Keypad Reader:

The keypad reader can be 4 Bits, 8 Bits (ASCII), or 10 Bits output format.

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Wiegand input bits	8 (4 or 8 or 10) #
	(factory default is 4bits)
3. Exit	*

Choose the below operation according to the PIN output format of your reader.

Remarks: 4 means 4 bits, 8 means 8 bits, 10 means 10 digits virtual number.

Add PIN Users:

To add PIN users, after enter into programming mode on 2CS, PIN(s) can be input/ added on either 2CS controller or the external Keypad Reader.

• Delete PIN Users: the same way as add users.


WIEGAND READER MODE

2CS can work as Standard Wiegand Reader, connected to the third party Controller--- 7 3 #

Notes:

2CS reads EM card only.

Connection Diagram

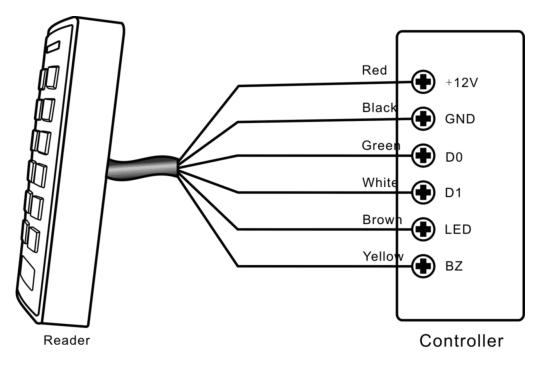

Notes:

• When set into Wiegand Reader mode, nearly all settings in Controller Model will become invalid. And Brown & Yellow wires will be redefined as below:

-Brown wire: Green LED light control

-Yellow wire: Buzeer control

• If you need to connect Brown/Yellow wires:

When the input voltage for LED is low, the LED will turn into Green; and when the input voltage for Buzzer is low, it will sound.

Set Wiegand Output Format

Please set the Wiegand output format of Reader according to the Wiegand intput format of the Controller.


Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Wiegand output bits	8 (26~37) # (factory default is 26bits)
PIN output bits	8 (4 or 8 or 10) # (Factory default is 4bits)
3. Exit	*

ADVANCE APPLICATION

User Information Transfer

The 2CS supports the User Information Transfer function, and the enrolled user (cards, PINs) can be transferred from one (let's name it Master Unit) to another (let's name it Accept Unit). Maximum 10pcs accepts units can be transferred once.

Connection Diagram:

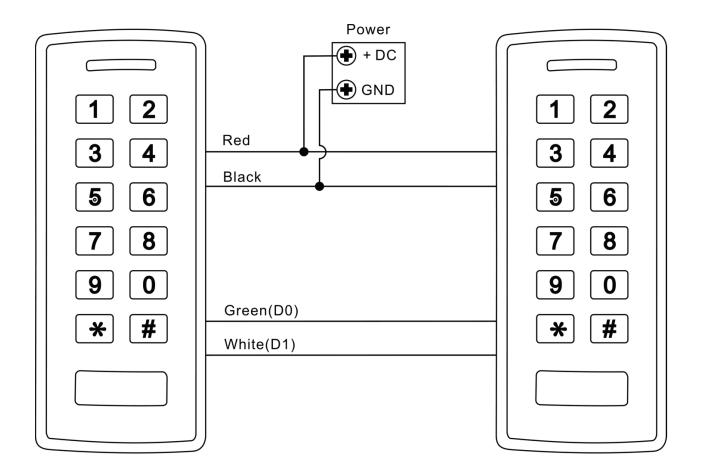

Remarks:

- The Master units and Accept units must be 2CS or other compatible.
- The Master Code of the Master Unit(s) and the Accept Unit(s) must be set to the same.
- Program the transfer operation on Master Unit only.
- If the Accept Unit(s) are already with the users enrolled, it will be covered after transferring.
- For full 1000 users enrolled, the transfer takes 3 minutes.


Set Transferring on Master Unit:

Programming Step	Keystroke Combination	
1. Enter the programming mode	* (Master Code) #	
2. Set transferring	96#	
Within 3 minutes, Green LED shines, after one beep, the LED will turn into Red, which means		
the users' information has been transferred successfully.		
3. Exit	*	

Interlock

The 2CS supports the Interlock funciton. It is of two keypads for two doors, and mainly used for banks, prisons, and other places where a higher level security is required.

Connection Diagram:

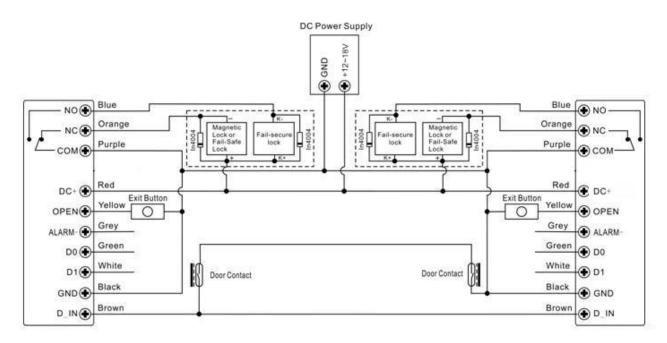

Remarks: The Door Contact must be installed and connected as the diagram.

Let's name the two 2CS Keypads as "A "and "B" for two doors "1" and "2"

Step 1:

Enroll the users on Keypad A, then transfer the users' information to Keypad B by "User Information Transfer" funciton.

Step 2:

Set both of the two readers (A and B) to Interlock function

Programming Step	Keystroke Combination
1. Enter Program Mode	* (Master Code) #
2. Interlocked-OFF	90# (factory default)
OR	
2. Interlocked-ON	91#
3. Exit	*

The interlock operation is finished,

When and only door 2 is closed, the user can read the valid card or input PIN on Reader A, door 1 will open; then when and only door 1 closed, read valid card or input PIN on Reader B, door 2 will open.

2CS- Simplified Instruction	
Function description	Operation

Enter the programming mode	*- 123456 - #
	then you can do the programming
	(123456 is the factory default master code)
change the master code	0 – new code - # - repeat the new code - #
	(code: 6 digits)
Add card user	1- Read Card - #
	(can add Cards continuously)
Add PIN user	1- PIN-#
Delete user	2 – Read Card -# for Card user
	2 – PIN -# for PIN user
Exit from the programming mode	*
How to release the door	
Card User	Read card
PIN User	Input PIN #